

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 78-66

WASTE DISCHARGE REQUIREMENTS
FOR
JOHN BEYLIK RECREATIONAL VEHICLE PARK
Northwest of Palm Springs - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. John R. Beylik (hereinafter also referred to as the discharger), 519 South Walnut St., La Habra, California 90631, submitted a Report of Waste Discharge dated May 8, 1978.
2. The discharger proposes to discharge a maximum of 19,500 gallons-per-day of domestic sewage from a recreational vehicle park designed to have 131 spaces and 4 restrooms. The wastewater is to be disposed of by means of septic tanks and seepage pits located in the SE $\frac{1}{4}$ of the SW $\frac{1}{4}$ of Section 10, T3S, R3E, SBB&M.
3. The discharger has reserved areas of sufficient size for 100% replacement of the seepage pits. These areas are designated on Attachment "A" incorporated herein and made a part of this Order.
4. The discharger proposes to periodically discharge swimming pool wastewater onto landscape plantings.
5. The Water Quality Control Plan for the West Colorado River Basin was adopted by the Board on April 10, 1975. The Basin Plan contains water quality objectives for Coachella Hydrologic Subunit.
6. The beneficial uses of the groundwaters of the Coachella Hydrologic Subunit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply

*Superseded
by 85-81
8/7/85*

85-081

7. The Riverside County Planning Commission has prepared Negative Declaration EA 556 (filing date March 6, 1974) for this proposed park. This assessment states that this project will not have any significant adverse effects on the environment.
8. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the proposed discharge.
9. The Board in a public meeting heard and considered all comments pertaining to the proposed discharge.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage and swimming pool wastewater shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. There shall be no discharge of wastewater within 200 feet of any domestic water well.
5. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
6. Septic tank cleanings shall be discharged only by a duly authorized service.
7. Swimming pool wastewater shall not be discharged into a sewage disposal system.

B. Provisions

1. The areas reserved for 100% replacement of the seepage pits, as shown on Attachment "A", shall at all times be retained servient to this recreational vehicle park, for the purpose of providing additional subsurface sewage disposal capacity, until such time as this park is connected to a municipal sewerage system.


2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of waste.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
4. Prior to any future change of ownership of this recreational vehicle park, the discharger shall:
 - a. Specify as a condition of transfer that said sewage disposal areas must remain servient to the park, for the purpose of providing subsurface sewage disposal capacity, until such time as this park is connected to a municipal sewerage system.
 - b. Notify the succeeding owner, in writing, of the existence of this Order, and forward a copy of said correspondence to the Regional Board.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on July 12, 1978.

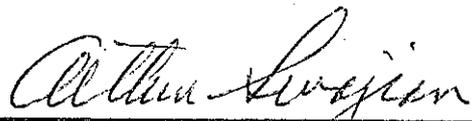

Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

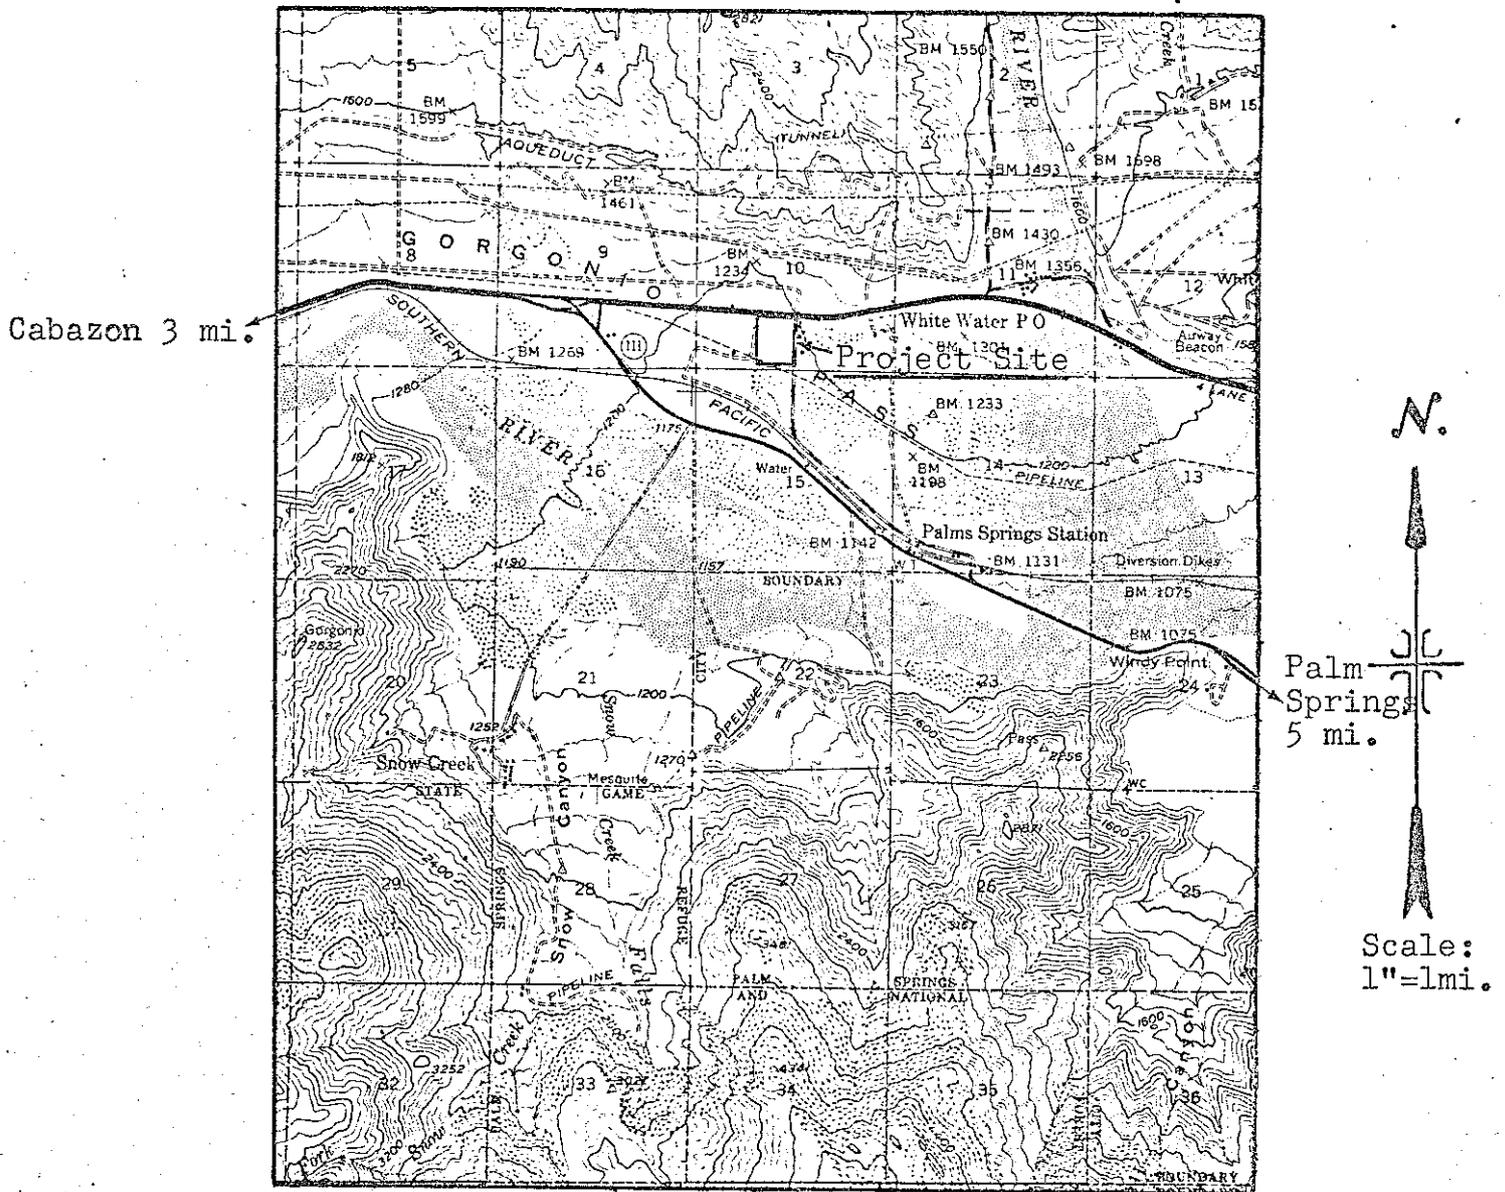

SITE MAP

JOHN BEYLIK RECREATIONAL VEHICLE PARK
 Northwest of Palm Springs - Riverside County
 Location of Discharge: SE $\frac{1}{4}$, SW $\frac{1}{4}$ of Section 10, T3S, R3E, SBB&M
 USGS Palm Springs 15 min. Topographic Map

Order No. 78-66


Interstate 10

N



Scale:
1" = 180'

- Septic Tank
- Seepage Pit
- 100% Back-up Seepage Pit Area

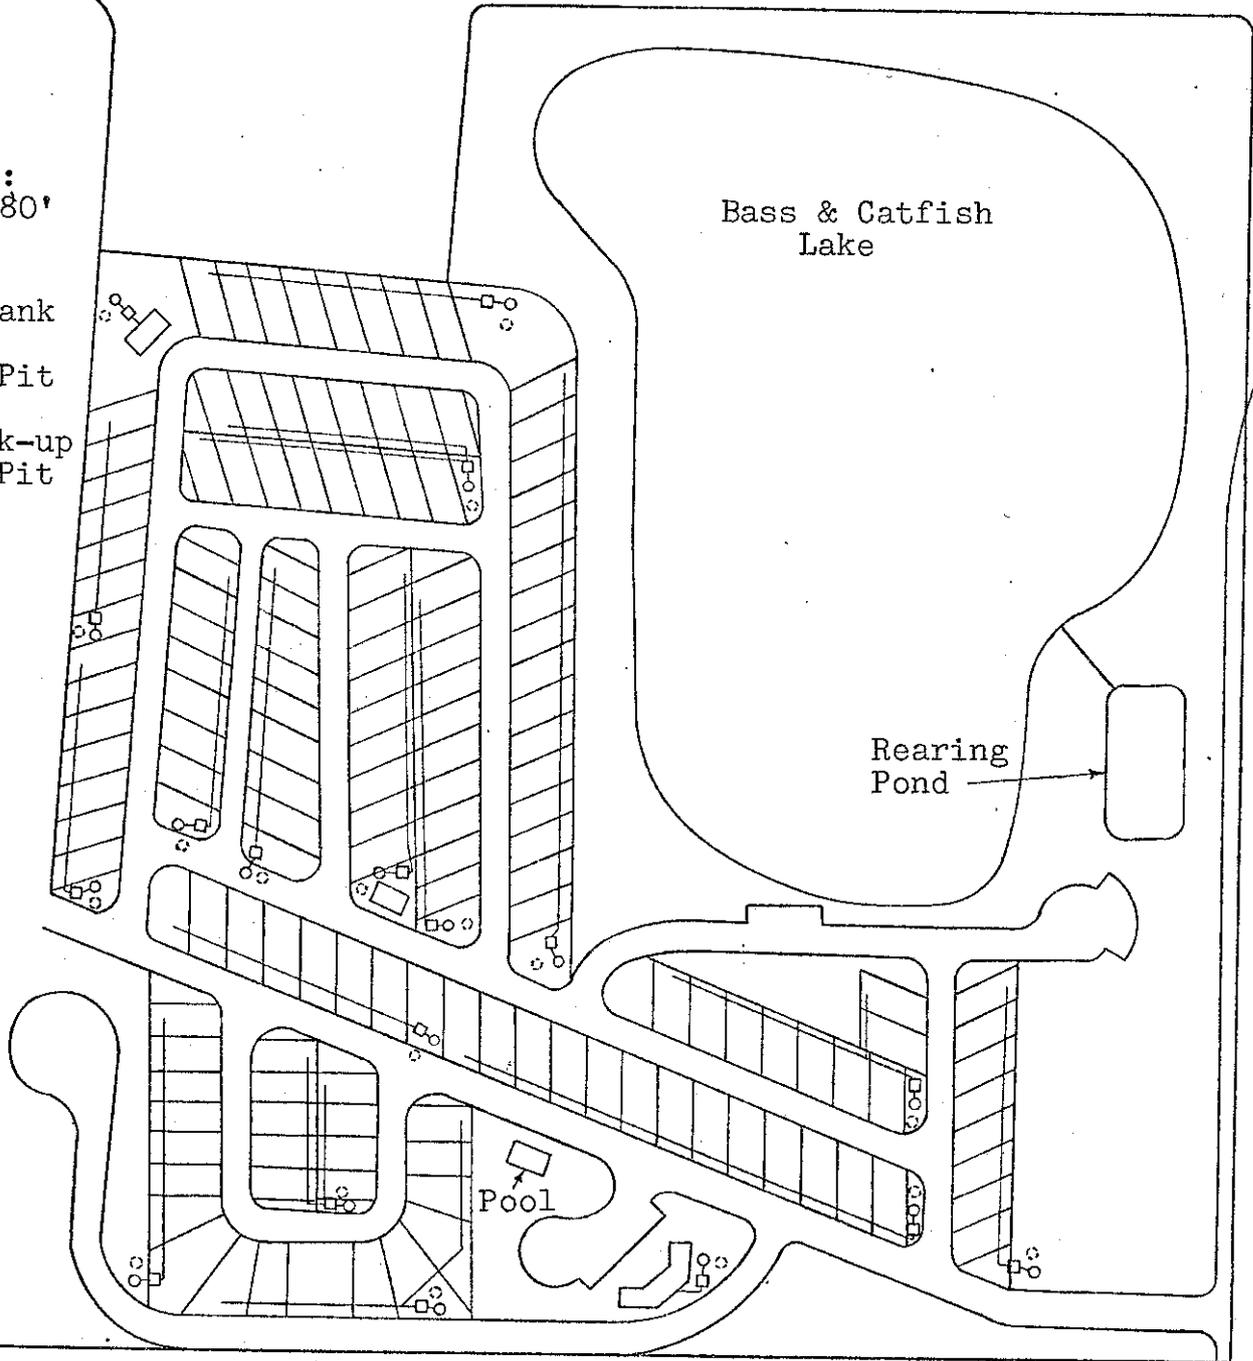

Tipton Road

ATTACHMENT A

JOHN BEYLIK RECREATIONAL VEHICLE PARK
Northwest of Palm Springs - Riverside County

Order No. 78-66