

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 89-003

WASTE DISCHARGE REQUIREMENTS
FOR
BORREGO SPRINGS PARK COMMUNITY SERVICES DISTRICT
Borrego Springs - San Diego County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Borrego Springs Park Community Services District (hereinafter also referred to as the discharger), P.O. Box 306, Borrego Springs, California 92004, supplied the updated information on the discharge of waste on October 21, 1988.
2. The discharger is presently discharging a maximum of 12,000 gallons-per-day of domestic sewage from a housing subdivision. The sewage is treated in an activated sludge treatment plant and is discharged to infiltration basins located in the NE 1/4 of Section 9, T11S, R6E, SBB&M.
3. There are no domestic wells within 500 feet of the discharge facilities described in Finding No. 2 (above).
4. The discharge has been subject to waste discharge requirements adopted in Board Order No. 83-101.
5. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
6. The beneficial uses of ground water of the Anza-Borrego Hydrologic Unit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply
7. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
8. The Board in a public meeting heard and considered all comments pertaining to the existing discharge.
9. These waste discharge requirements govern an existing facility, which the discharger is currently operating, and therefore is exempt from

RESCINDED BY
BOARD ORDER NO. 98-098
11/12/98

the provisions of the California Environmental Quality Act in accordance with Section 15301, Chapter 3, Title 14 of the California Code of Regulations.

IT IS HEREBY ORDERED that the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create pollution or nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewerage system described in Finding No. 2 (above).
3. A minimum freeboard of two (2) feet shall be maintained in each basin.
4. Treated or untreated sludge or similar solid waste materials shall be disposed only at locations approved by the Regional Board.
5. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the discharge.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the discharge facilities.
8. There shall be no discharge, bypass, or flow of treated or untreated sewage to any surface water or any channel which drains thereto.
9. Infiltration facilities shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater by evaporation.
10. Standby facilities shall be provided in the event of pump and/or commercial power failure.


B. Provisions

1. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
2. The discharger shall comply with the "Monitoring and Reporting Program No. 89-003", and future revisions thereto, as specified by the Regional Board's Executive Officer.

3. The discharger's wastewater treatment plant shall be supervised and operated by persons possessing certification of appropriate grade pursuant to Subchapter 14, Chapter 4, Title 23, California Code of Regulations.
4. In the event of any change in operation, or in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify in writing to this Board of such change; and
 - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

IT IS FURTHER ORDERED that Board Order No. 83-101 be superseded by this Order.

I, Phil Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 25, 1989.

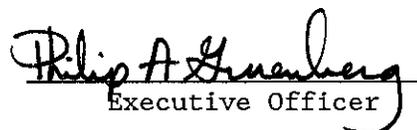
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 89-003
FOR
BORREGO SPRINGS PARK COMMUNITY SERVICES DISTRICT
Borrego Springs - San Diego County

Location of Discharge: NE 1/4, Section 9, T11S, R6E, SBB&M

EFFLUENT MONITORING

Wastewater discharged from the treatment facilities shall be monitored for the following:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	6-Hr. Composite ¹	Quarterly
Suspended Solids	mg/l	6-Hr. Composite ¹	Quarterly
Flow (Total Plant Effluent)	Gallons/ Day	Flow Measurement	Daily ²

The discharger shall implement the above monitoring program within 30 days of the effective date of this Board Order No. 89-003.

SEWAGE SLUDGE

The discharger shall report quarterly on the quantity, method, and location of sewage sludge discharged.

REPORTING

Quarterly monitoring reports shall be submitted to the Regional Board by January 15, April 15, July 15, and October 15 of each year.

Daily monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

¹6-Hr. composite during the peak flow period.

²For each day with average monthly flow calculated.

Submit monitoring reports to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260


ORDERED BY:

Philip A. Greenberg
Executive Officer

January 25, 1989

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

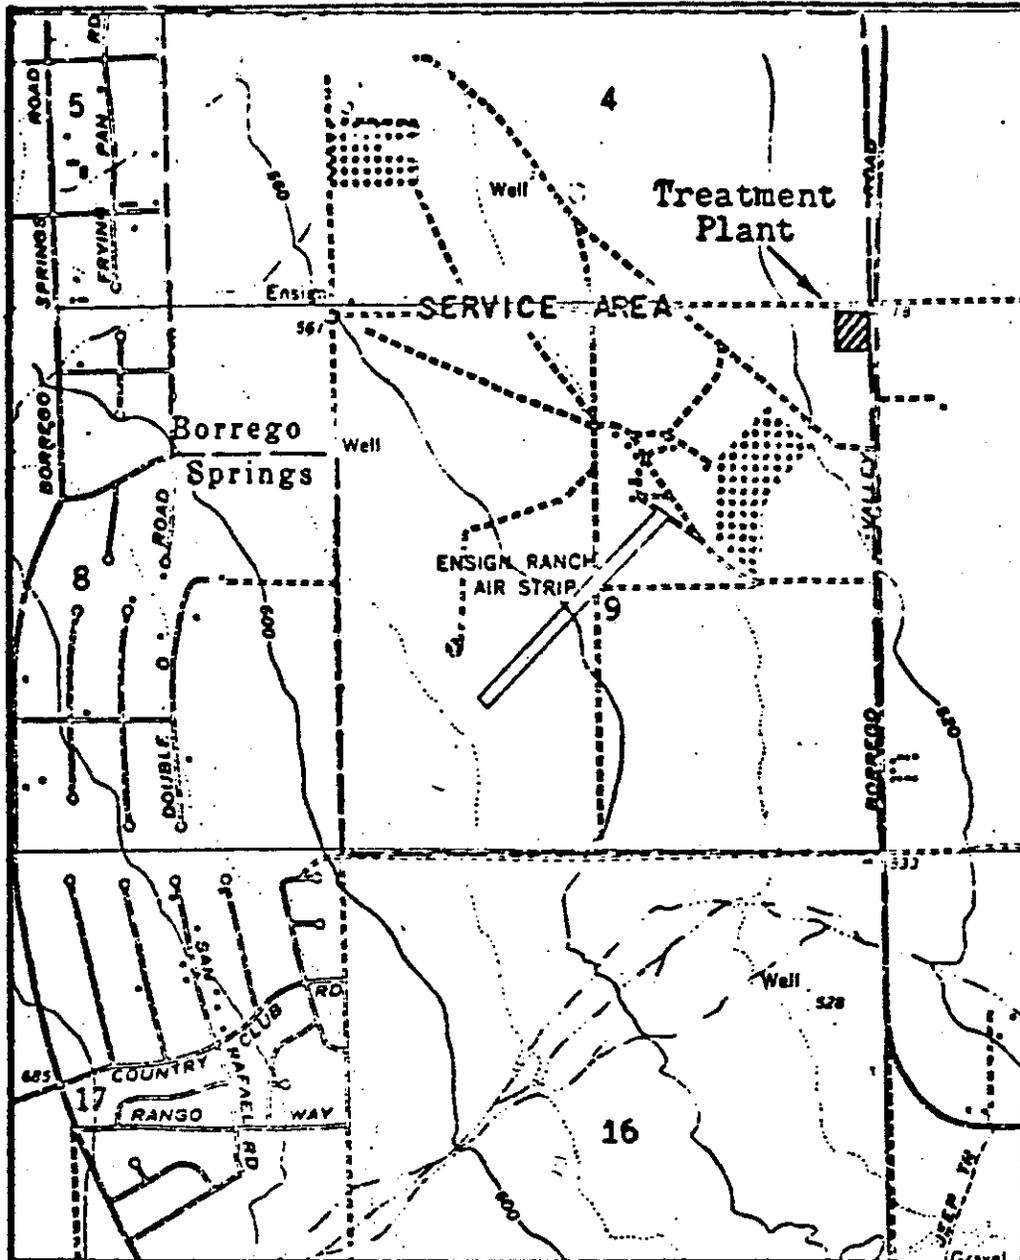

SITE MAP

BORREGO SPRINGS PARK COMMUNITY SERVICES DISTRICT
Borrego Springs - San Diego County
NE 1/4, Section 9, T11S, R6E, SBB&M
Borrego Sink 7.5 Topographic Map

Order No. 89-003